


NTC 449.16
M-2 5/10/83
DRAWING NUMBER 14
DRAWING NUMBER 14

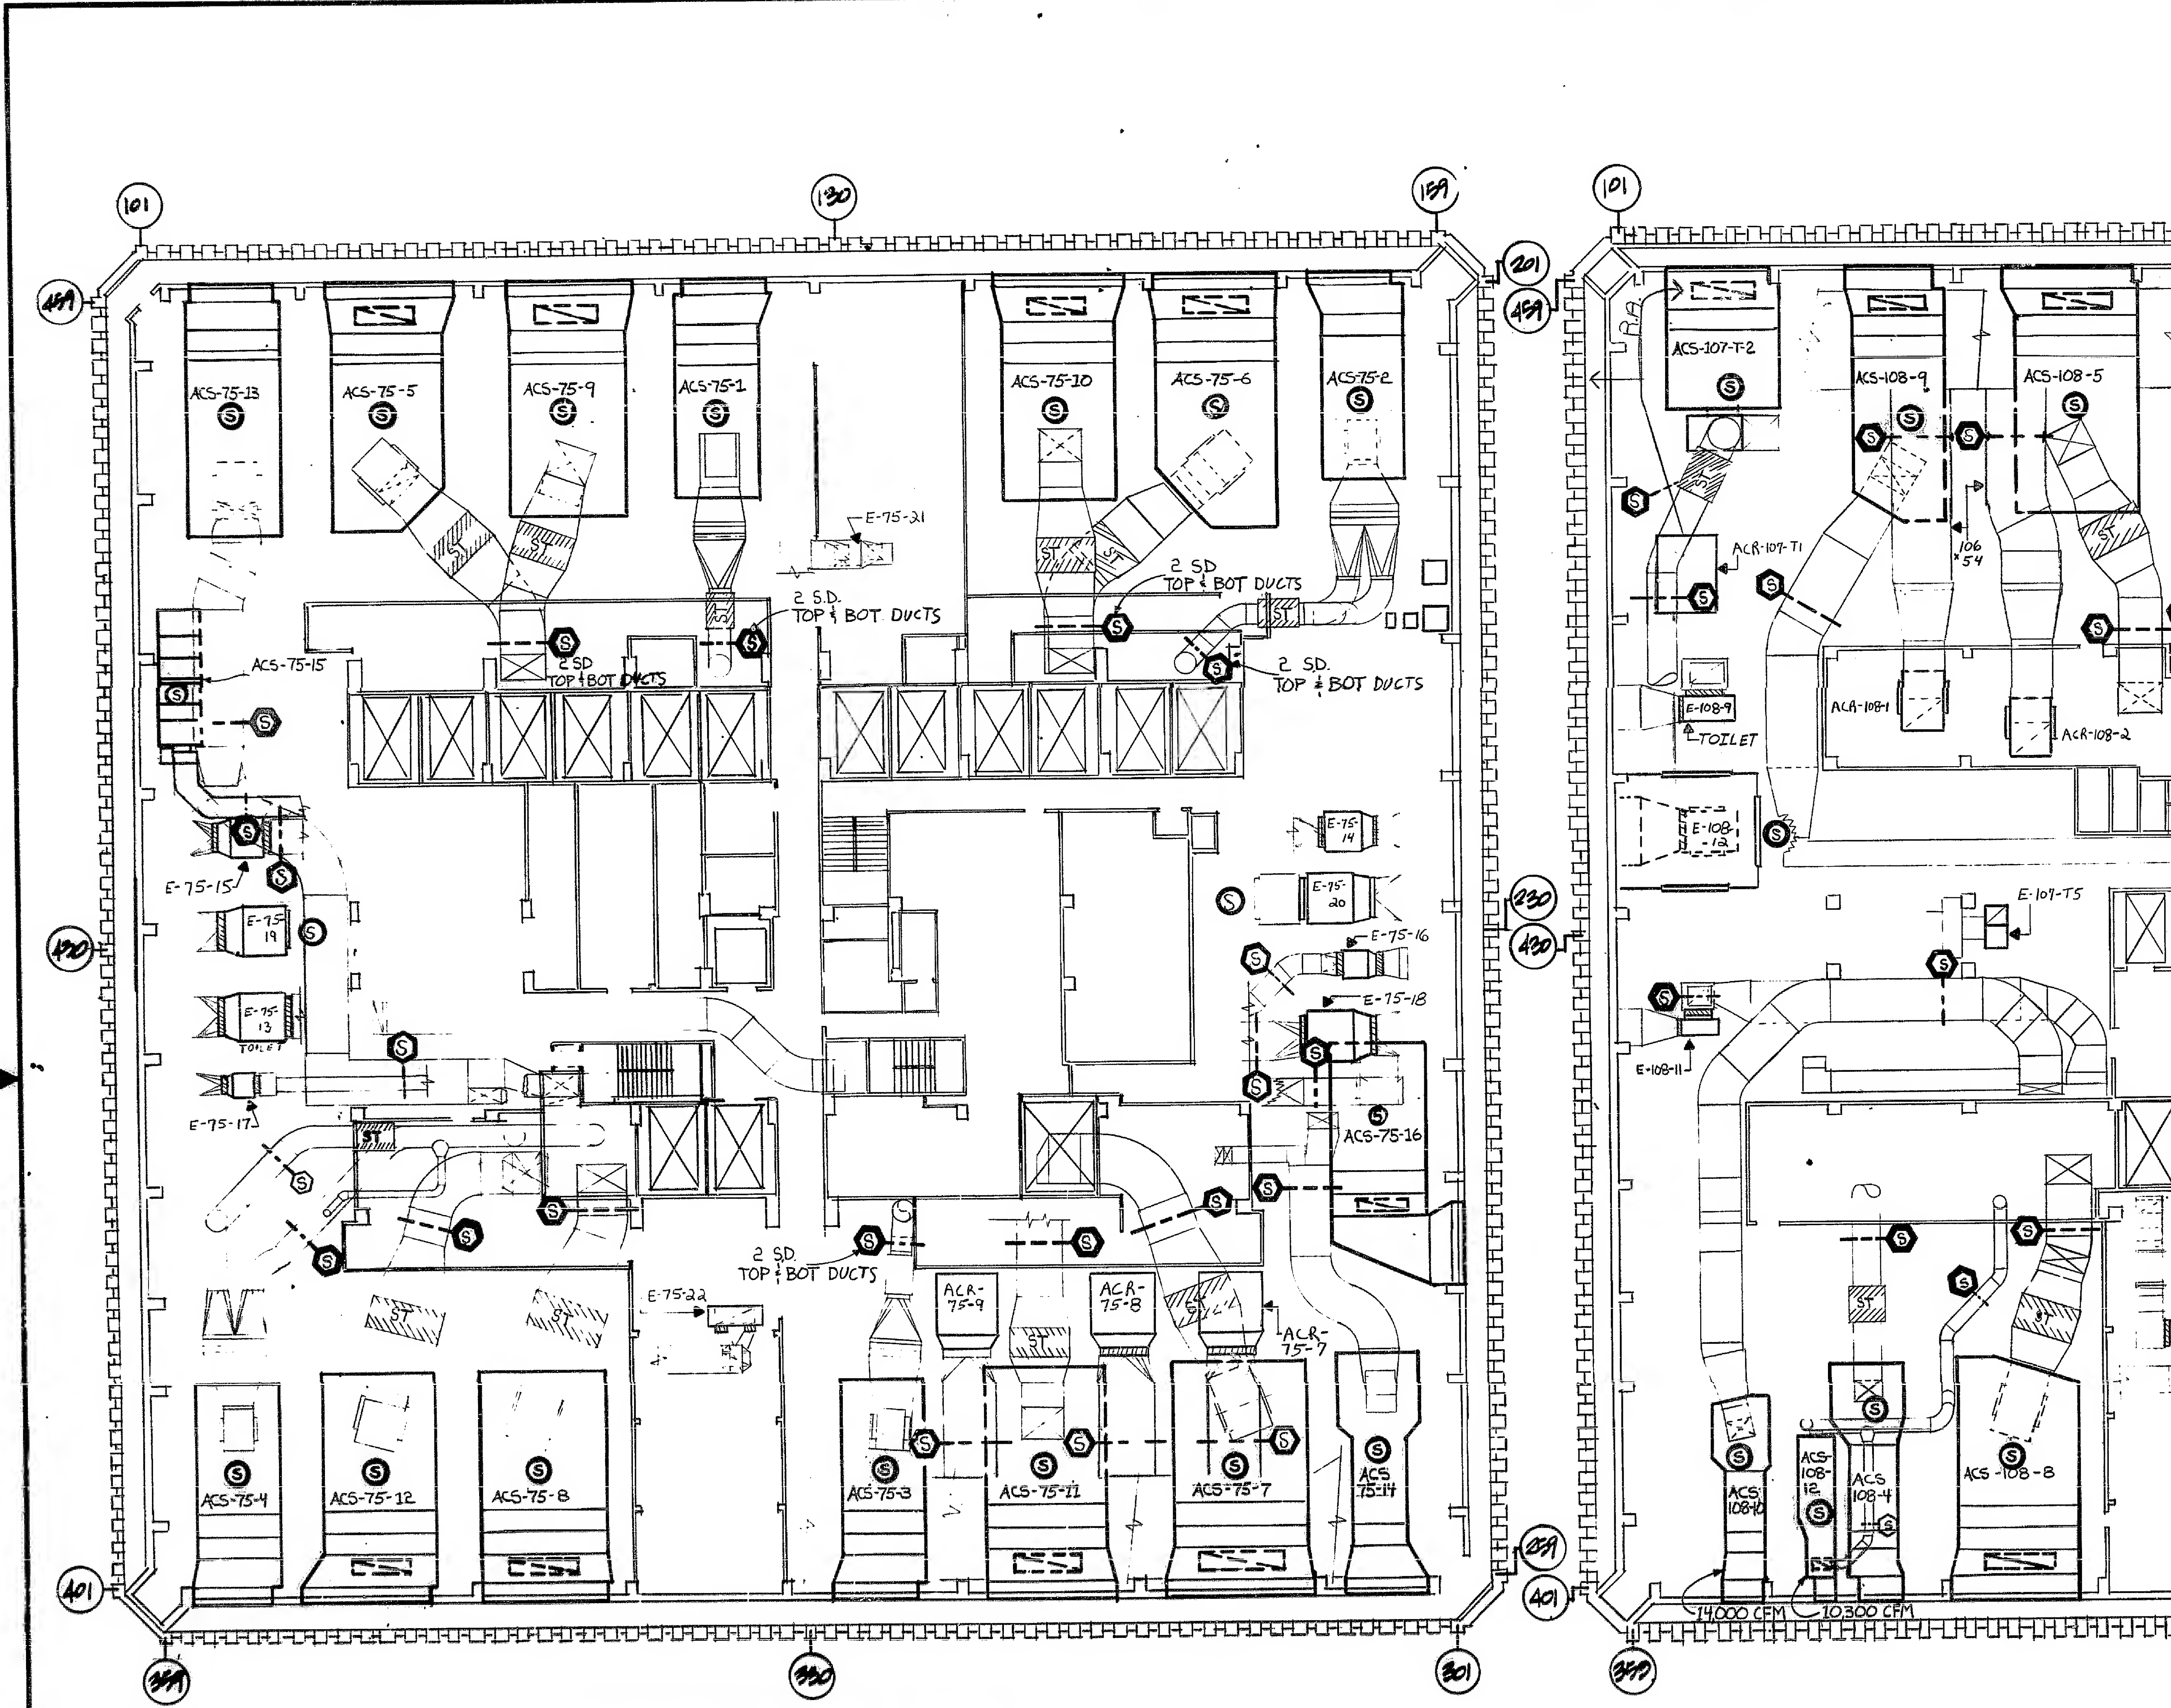

PLAN OF M.E.R.-75TH FLOOR

PLAN OF M.E.R.

NOTE B - Typical return air duct smoke detectors

NOTE A - Typical return air duct smoke detectors

Detectors shown in Southeast Quadrant for return fans ACR 75-7, 8, and 9 are typical for all four quadrants in 41st and 75th floors mechanical equipment rooms, both towers.

Each return duct requires two detector assembly, including sampling tubes.

Detectors are to be installed in vicinity of existing detectors.

Detectors shown in Northwest Quadrant for return fans ACR 108-1 and 2 are typical for all four quadrants in 7th and 108th floors mechanical equipment rooms, both towers.

Each return duct requires one detector assembly including sampling tubes.

Detectors are to be installed in vicinity of existing detectors.

NOTES
FOR NOTE